




# Specialised Ventilation for Healthcare Society

**Updated Briefing & Guidance on Considerations for the  
Ventilation Aspects of Healthcare Facilities for Coronavirus**

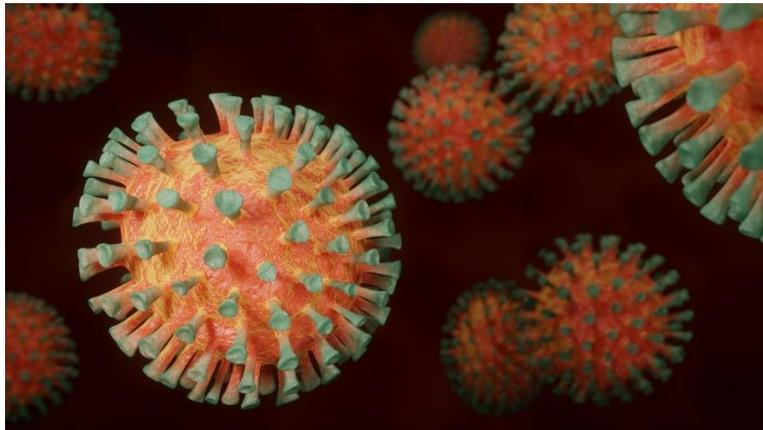

**Updated 27<sup>th</sup> April 2020**

---

**Document SVHSoc.03-V4.**

# Coronavirus COVID-19 Guidance

## The Specialised Ventilation for Healthcare Society (SVHSoc.)

The Society was formed in November 2014 with the aim of bringing together those who were practicing or wished to become Authorising Engineers (Ventilation) (AE(V)) or who have a more general interest in Ventilation in the Healthcare setting.

- The SVHSoc. meet several times a year at various locations around the UK.
- Full membership of the Society is open to registered AE(V)'s.
- The Society "Code of Conduct" is issued with all quotations for AE(V) services.
- The Society maintains a register containing details of practicing AE(V)s.
- A set of competencies have been drawn up for prospective AE(V)s.
  
- Associate membership is open to anyone interested in Ventilation for Healthcare.
- A significant portion of the Society meetings is given over to discussing and clarifying interpretation of HTM03-01 and other healthcare ventilation standards.

Further information concerning the SVHSoc. may be obtained from:-

Malcolm Thomas - President SVHSoc. - [malcolmthomas.vent@btinternet.com](mailto:malcolmthomas.vent@btinternet.com)  
+447814077474

Graham Powell – Chair SVHSoc. – [grahampowell@grahampowellconsultants.co.uk](mailto:grahampowell@grahampowellconsultants.co.uk)  
07958627587

John Rayner – Secretary SVHSoc. – [john.rayner@turnerPES.co.uk](mailto:john.rayner@turnerPES.co.uk)  
07714523131

-----  
The following documents have been issued by SVHSoc. to help clarify Healthcare Ventilation requirements

<b>SVHSoc.01-V3.0</b>	<b>Operating Theatres - Energy Control Strategies and the Surgeon's panel</b>
<b>SVHSoc.02-V1.0</b>	<b>Change in Air Filter Test and Classification standards</b>
<b>SVHSoc.03-V4.0</b>	<b>Coronavirus COVID-19 Guidance</b>

# Coronavirus COVID-19 Guidance

## Coronavirus COVID-19

### Acknowledgments

Lead Author - Andrew Poplett  
Principal contributor - Graham P. Taylor

The following individuals and organisations were consulted during the preparation of this document. Their contribution is gratefully acknowledged.

#### SVHSoc. Members & Associates

Malcolm Thomas  
Graham Powell  
John Rayner  
Jerry Slann  
Paul Jameson  
Tim Buckell  
Joe Hughes  
David Livingstone  
Colin Gaffney  
Ian Storrar  
Siggi Volkmann  
Lynn Rogers  
Eddie McLaughlan  
Harry Evans  
John Adamson

Ray Hughes  
Jez Beales  
Richard Harris  
Paul Crothers  
John Middleton  
Joe Gill  
Andy Smith  
Stephen Morris  
James Dagnall  
Paddy Fitzpatrick  
Edward Wright  
James Draycott  
Lester Stuart  
Graham Stuart

#### Consultant Microbiologists

Professor Rob Townsend  
Dr Robert Porter

#### University of Birmingham

Mr Andrew Thomas

Orthopaedic Consultant

#### PHE

Peter Hoffman

© The content of this document may be freely reproduced and used providing the source is acknowledged as being the Specialised Ventilation for Healthcare Society (SVHSoc.).

# Coronavirus COVID-19 Guidance

## Specialised Ventilation for Healthcare Society

SVHSoc.03-V4.0 (27<sup>th</sup> April 2020)

### Contents

<b>Introduction</b>	<b>Page 5</b>
<b>Standards and Technical Specifications</b>	<b>Page 6</b>
<b>SVH Society Supplementary Advice</b>	<b>Page 7</b>
Use of Theatres as CCUs	
Neutral Pressure Theatres	
NHS Nightingale Units	
Community Healthcare Ventilation systems	
<b>None Ventilation Related Considerations</b>	<b>Page 15</b>
<b>Ventilation Maintenance Considerations</b>	<b>Page 16</b>
Breakdowns and Repairs	
Filter Changing	
PPE	
<b>Endnote</b>	<b>page 18</b>
<b>References</b>	<b>Page 18</b>

# Coronavirus COVID-19 Guidance

## Introduction

Following peer review, recent feedback and experience from SVH Society members, and advice from Public Health England (Peter Hoffman) the briefing and guidance from the SVHSoc has been updated to reflect the current official guidance and to provide a range of options and areas for consideration for healthcare estates professionals to provide enhanced levels of protection for patients, staff, and visitors.

The briefing is intended to provide an overview of the issues and points to consider when assessing the ventilation strategy and options. It has also been updated to provide some initial maintenance considerations and precautions which may need to be considered. It is intended that this briefing and guidance will be subject to regular review and updates as details, information, and the situation continues to develop.

Current guidance on the lifespan of the virus once outside the body is still to be fully established, however current estimates are that it could survive anywhere between a few hours up to 3 to 4 days on hard surfaces and is spread by both primary direct exposure (breathing in droplets expelled from an infected person from coughing or sneezing) and secondary contact by touch (touching a surface which has been contaminated and transferring this contamination by touch to the mouth, nose or eyes). "Coronaviruses are mainly transmitted by large respiratory droplets and direct or indirect contact with infected secretions. They have also been detected in blood, faeces and urine and, under certain circumstances, airborne transmission is thought to have occurred from aerosolised respiratory secretions and faecal material". That level of airborne transmissibility is specifically associated with certain aerosol generating procedures (AGPs).

That COVID-19 has been termed an airborne infection is an indication that it is capable of transmitting via an airborne route in certain circumstances, not that its mode of spread is primarily airborne nor that any aerosol remains sufficiently concentrated to be infectious over longer distances other than in the immediate vicinity of a dispersing patient.

The PHE guidance is under constant review and updated as necessary. The current guidance can be found at:

<https://www.gov.uk/government/publications/wuhan-novel-coronavirus-infection-prevention-and-control>

Ventilation can contribute to an isolation or protection strategy to assist in minimising the spread of the virus, however a number of factors need to be considered, not least of all the provision of adequate ventilation to provide dilution of any airborne contamination, with other factors including;

- Area / rooms where isolation can be established
- Physical / fabric of the room construction / air permeability rates (e.g. solid ceilings)
- Surrounding areas of clinical activity
- Room volume and airflow / room pressure differentials (dilution effects)
- Provision and location of ventilation (e.g. ceiling mounted supply with low level extract)

## Coronavirus COVID-19 Guidance

- Point of discharge and filtration of any extracted air
- Levels of isolation and practical considerations
- Decontamination of the area between patients
- Protection of all potentially exposed staff groups (clinical, cleaning, and estates)
- Potential risks associated with oxygen enriched atmospheres

### Standards and Technical Specifications

HTM 03-01 sets out the overall guidance for ventilation of healthcare premises with addition specific guidance on isolation facilities being contained within HBN 04-01 Supplement and HBN 04-02 for critical care units (it should be noted that the HBN's can be interpreted as containing some conflicting advice for ventilation strategies, however the objectives are similar). These documents should be used as the basis for all ventilation strategies in conjunction with advice from the Infection Prevention Control (IPC) team, WHO & PHE support. Overall it needs to be an issue where IPC set the room criteria and then estates can look to see how it can be provided.

*Note/commentary from PHE - Standards and technical specifications within the UK we are rapidly moving to a position where COVID patients will be cohorted on bays in wards. Beyond specific "aerosol generating procedures" (AGPs) there is not thought to be an airborne risk and staff do not require respirators. This can be seen from the "general ward" guidance for AGPs in the PHE guidance.*

*Table 1: Transmission based precautions (TBPs): Personal protective equipment (PPE) for care of patients with pandemic COVID-19*

	<i>Entry to cohort area (only if necessary) no patient contact*</i>	<i>General ward *</i>	<i>High risk unit ICU/ITU/HDU</i>	<i>Aerosol generating procedures (any setting)</i>
<i>Disposable Gloves</i>	<i>No</i>	<i>Yes</i>	<i>Yes</i>	<i>Yes</i>
<i>Disposable Plastic Apron</i>	<i>No</i>	<i>Yes</i>	<i>Yes</i>	<i>No</i>
<i>Disposable Gown</i>	<i>No</i>	<i>No</i>	<i>No</i>	<i>Yes</i>
<i>Fluid-resistant (Type IIR) surgical mask (FRSM)</i>	<i>Yes</i>	<i>Yes</i>	<i>No</i>	<i>No</i>
<i>Filtering face piece (class 3) (FFP3) respirator</i>	<i>No</i>	<i>No</i>	<i>Yes</i>	<i>Yes</i>
<i>Disposable Eye protection</i>	<i>No</i>	<i>Risk assessment</i>	<i>Risk assessment (always if wearing an FFP3)</i>	<i>Yes</i>

## Coronavirus COVID-19 Guidance

**Notwithstanding the above, in the SVHSoc's opinion, a standard for any facility used, should strive to achieve the following performance criteria;**

- The room/area should achieve between 6 to 12 air changes per hour. The greater the air changes provided the more effective the dilution effect provided that it does not interfere with other critical elements.
- The room/area ideally should be at least neutral to the surrounding areas (0 to -10 Pa)
- If achievable the room/area should have sufficient air supply and extract to achieve open door protection, however this may not be possible other than in a PPVL room or air-locked facility.
- The room should ideally have a protected lobby (if possible) with barrier or isolation nursing care and PPE worn by all staff
- Immediately outside but adjacent to the room there should be a wash hand basin and an area for de-gowning. If the room has a lobby (PPVL) then de-gowning should take place within the lobby.

### **Droplet Transmission & Airborne Dilution / Clearance**

The PHE have stated that in their opinion there is very little to no risk of any viable virus transfer beyond the immediate clinical area through air gaps in doors or via pressure stabilisers as the water droplets would not survive the distance or routes without very significant dilution and desiccation. This is especially true for a patient who is anaesthetised and on a closed breathing circuit. All staff within a critical care environment should be wearing full PPE. There is however emerging anecdotal evidence that the concentration of exposure may have a direct correlation to the severity of any subsequent infection and therefore dilution of aero-microbiological contamination is considered an essential precaution, even where PPE is worn.

Definitive scientific evidence that the infection is not airborne is not yet clear, and on a precautionary principle it should be assumed that it can be airborne on droplet nuclei, until proved otherwise, certainly for short distances within confined or poorly ventilated environments. Droplets expelled during AGP's can be anywhere from 1 µm to 2mm in size with an estimated average size of 50 µm. A droplet of 100 µm will fall to the floor at around 30cm/s and a droplet of 30 µm will fall at a rate of around 3cm/s, so droplets ejected from a patient by coughing/breathing are estimated to travel around 1 – 4 metres and with a downward displacement ventilation system in operation are likely to fall/be pushed to the floor very quickly. Added to this is the fact that patients are in a horizontal position typically 1m above the floor level and if ventilated on a closed breathing circuit making release of droplets less likely.

After any treatment or surgical procedure any residual airborne particles are cleared from a room at a rate of 63% per air change, therefore within 6 air changes 99.8% of any airborne contaminants will have been removed. In an operating department achieving the recommended air change rate of 25 air changes per hour (HTM 03-01 standard) the room will be effectively clear of residual airborne particles within 15 minutes or 20 minutes if achieving 20 air changes per hour (HTM 2025 standard). A similar effect will be achieved within a treatment or CCU space although these will typically achieve between 15-10 ACH and will correspondingly achieve the required 6 air changes within 24-36 minutes.

# Coronavirus COVID-19 Guidance

The practical implication of this guidance is that the current supply and extract ventilation systems offer a significant dilution effect to a facility and should remain in use and are unlikely to offer any risk to building occupants / users.

## General Options and Considerations

A negative pressure or PPVL room with lobby is the likely preferred locally achievable option. Extract filtration, provided the air is discharged in an appropriate location, is not likely to be required as it is likely to significantly impact on the airflow performance and it will be necessary to undertake a risk based assessment on the use of extract filtration and consider system upgrades to maintain overall airflow performance. The point of discharge of any extract ventilation system should be assessed to ensure that it does not provide a route of cross contamination.

If however multiple PPVL rooms are not available then a side room with a lobby and its own en-suite is likely to be the next best option. The extract from the en-suite will provide some degree of pressure cascade / regime although it is unlikely to provide open door protection and the point of discharge location will again require to be assessed. If a side room has supply air then this should provide a minimum fresh air rate of at least 6 ACH but ideally be less than the extract air volume to maintain the room at a neutral/negative pressure, whilst not compromising dilution effect.

In most clinical care environments the vast majority of openable windows have security/restrictor arrangements to enhance user safety. In order to improve ventilation, it may be possible to undertake a risk assessed review to enable some windows to open more fully.

If an air scrubber/filtration unit is considered it will not provide any dilution or fresh air supply into the room, but may remove some contamination from the air, however the issue of how to de-contaminate and dispose of the filter unit between patients will need consideration (see maintenance considerations below).

As the spread of the virus has continued hospitals have been required to identify and consider designating entire ward areas or even buildings as isolation facilities. This cohorting of cases has been driven by clinical risk assessment based upon risk of cross contamination (between patients within the isolation space) and the need for clinical support/treatment.

In these circumstances it is likely that the capacity of the electrical and medical gas infrastructure (oxygen, medical air, and vacuum) systems has been the greatest challenge and ventilation has been a secondary issue, however some basic principles should still be considered;

- Wards with single bedrooms with en-suite facilities are likely to offer the best solution.
- Maintaining a good air change rate of between 6 - 12 ACH is considered appropriate to maintain a dilution effect for both patients and staff protection.
- The extract rate should ideally be greater than the supply where practical, to create an appropriate pressure cascade to surrounding areas, ideally with supply in corridors and extract by means of en-suite facilities and dirty extract systems, in all cases ward doors to circulation spaces MUST be kept closed as far as reasonably practical.

## Coronavirus COVID-19 Guidance

- If open plan/multi-bed bay wards are used then a clinical assessment of risk relating to cross contamination will be needed, however areas with low level extract by each bed space are preferable.
- If the ventilation system (AHU) serves more than a single ward then the supply aspect is less critical as the airflow direction provides a level of protection, however an ACR of around 6 ACH should be considered as a minimum. Shared extract systems are less ideal and consideration should be given to separating or closing off non-essential extracts if practical. Extract systems should be inter-locked with supply systems to ensure that if the supply fails the extract continues to operate, however if the extract fails then the supply should also switch off, only as a short term measure until the extract system can be repaired / re-instated. If a failure is likely to be over 1 hour then the supply can be reinstated to provide both thermal comfort and dilution provided that it does not create a cross contamination risk.
- If an area or room is identified as being potentially suitable to be used as a temporary isolation facility it is advisable if possible to undertake a 'room air permeability or leakage test' to ensure air is contained within the room and does not leak to adjacent areas through suspended ceiling or service penetrations, (this may not be practical to achieve, given the urgency of demand).
- Any room used as a temporary holding or isolation facility should be stripped of all non-essential materials and soft furnishings.
- If you can locate an increased extract unit to provide a negative pressure environment then care will be needed when considering the distribution ducting and the exhaust air discharge point. Ducting and extract grilles should be located to ensure an even draw of air from around bed spaces and not rely on a single point at the end of the unit which draws air over adjacent patients and staff. The exhaust discharge however providing it is discharging to a safe external space (ideally at high level 3m above roof level) then HEPA filtration is unlikely to be required. Consider sealing any openable windows in the immediate vicinity (around 4m) of any low level discharges and avoid discharge over pedestrian paths/walkways.

### Use of Theatres as CCU's

As the need for critical care beds has increased some hospitals have identified areas which are suitable and have the required engineering and medical services to provide an appropriate and safe clinical environment. In many cases where patient ventilation / life support is required the theatre and associated recovery suites (freed up from elective procedures from mid-April) are considered as ideal. If kept for the exclusive use by non-infected patients the ventilation system is likely to need little modification or adjustment, however consideration may be given to lowering both supply and extract rates to save energy and ensure patient comfort (reducing ACRs to around 10 ACH would be appropriate).

Recovery areas are preferable to theatres in the first instance as the ventilation strategy of these spaces provides a good air change rate (15ACH) with neutral pressure cascade to surrounding areas and bedhead low level extract to provide a clean air path for staff protection.

## Coronavirus COVID-19 Guidance

Typically 2 CCU bed spaces could be provided per theatre with an addition bed located in the anaesthetic room if needed, (medical gases, adequate ventilation and electrical outlets are typically all present in these rooms). Recovery spaces are designed to provide 12-15 ACH and should be neutral to surrounding areas so no modifications to the ventilation system should be needed.

If it is proposed to use theatres as spaces to treat COVID 19 infectious patients then the airflows would need to be very carefully reviewed and adjusted to maintain a safe air change rate and provide an ideally neutral pressure regime to surrounding clinical and staff areas.

### Use of Theatres for COVID 19 infected patients Including Emergency Maternity Theatres

The following information reflects the current guidance from the centre for the use of theatres for known or suspected infected (COVID19) patients;

<https://www.gov.uk/government/publications/wuhan-novel-coronavirus-infection-prevention-and-control>

It is recommended that ventilation in both laminar flow and conventionally ventilated theatres should remain fully on during surgical procedures where patients may have COVID-19 infection. Air passing from operating theatres to adjacent areas will be highly diluted and is not considered by PHE to represent a significant risk.

- Theatres must be informed in advance of a patient transfer of a confirmed or possible COVID-19 positive case, the patient should be transported directly to the operating theatre and should wear a surgical mask if it can be tolerated.
- The patient should be anaesthetised and recovered in the theatre. Staff should wear protective clothing but only those at risk of exposure from aerosol generating procedures, i.e. during intubation need to wear FFP3 respirators and full gowns. Those closest to aerosol generation procedures are most at risk. The rapid dilution of these aerosols by operating theatre ventilation should minimise the exposure to operating room staff.
- Instruments and devices should be decontaminated in the normal manner in accordance with manufacturers' advice
- Both laryngoscope handle and blade should either be single use or reprocessed in the Sterile Supply Department. Video laryngoscope blades should be single use and scope/handle decontaminated as per manufacture instructions.
- Instruments must be transported safely to decontamination, following use.
- The theatre and all associated support areas should be cleaned as per local policy for infected cases, paying particular attention to hand contact points.
- Theatres should not be used by staff or patients for 20 minutes after the patient leaves.
- Possible or confirmed cases of COVID-19 should be placed at the end of the list where feasible

The follow information is provided to support or supplement this initial guidance.

# Coronavirus COVID-19 Guidance

## Neutral Pressure Theatres

With the current COVID19 infection issues there may be a requirement for an operating suite to be used for an infected or suspected patient. If airborne micro-organisms liberated from a patient during the surgical procedure are allowed to cascade out into the adjacent corridors, they could contaminate surfaces or infect other patients or the staff within the surrounding operating department. Although air passing from operating theatres to adjacent areas will be highly diluted and this is not considered by PHE to represent a significant risk.

The concept of a neutral pressure or infectious theatre is to maintain an appropriate and safe air change rate to the theatre space but instead of the traditional cascade arrange of air from the theatre suite to the surrounding areas it is based on a balanced air flow of both supply and extract from ideally within the theatre itself or as a minimum within the individual theatre suite.


The room provision and layout will be as for a conventional operating suite with the following variation to the ventilation scheme:

- The operating theatre will have a balanced supply and extract so that it is at the same pressure as the corridor.
- Air should not cascade from the theatre to the surrounding rooms so pressure stabilisers and / or transfer grilles will not be fitted.
- The preparation room could be dispensed with to avoid having stock that could become pre-contaminated. Sterile packs, instruments and consumables would be delivered to the theatre on a case by case basis. If a preparation room is required, then it should be maintained at 10Pa to both the theatre and corridor.
- The anaesthetic room should have a supply in excess of extract so that is maintained at 10Pa above both the corridor and theatre. There should be a pressure stabiliser between the anaesthetic and corridor but no transfer between the anaesthetic and theatre.
- The scrub should have an active extract as for a conventional operating suite but no pressure stabiliser between it and the corridor.
- The utility should be at -5Pa to the theatre and its corridor.
- The corridor extract will be sized to cater for the air leakage from the anaesthetic room only.

Overall the ventilation scheme should ensure that all air supplied to the operating theatre is removed in the theatre suite. The theatre should be neutral (at the same pressure) to the corridor so that when the theatre exit door is open there is effectively no interchange of air between them. Ideally when the preparation or anaesthetic doors are opened airflows from them into the theatre and not the other way.

# Coronavirus COVID-19 Guidance

The traditional theatre suite layout typically as below (or a variation thereof);

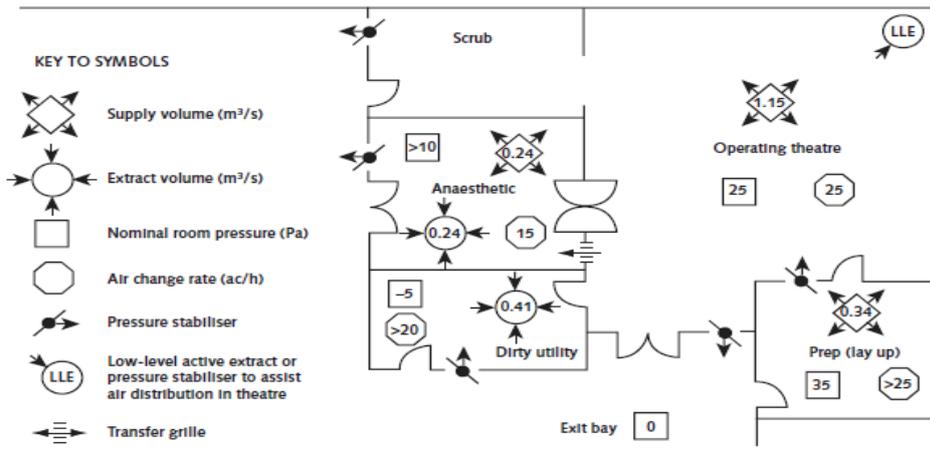

If sites are required to endeavour to transform existing positive pressure cascade theatres to create a neutral pressure theatre the following areas will need to be considered.

In line with guidance the patient should be brought into and out of the theatre through the anaesthetic room, but anaesthetised and recovered in theatre. The doors and any pressure stabilisers from the theatre to the corridor should be sealed and not used.

The lay-up prep area should only hold the minimum stock required for the given procedure, however the air cascade from the lay-up prep to theatre should be maintained as a positive differential.

The pressure stabilisers from both the scrub area to the corridor and the anaesthetics room to corridor should be sealed.

The dirty utility room should remain at a negative pressure differential to both the theatre and corridor.

Ideally the anaesthetics room should be positive pressure to the theatre, however this may not be practical, in which case the anaesthetics room should only have all surfaces as clear as practical and all surplus or spare equipment held elsewhere.

A full re-balance of the supply and extract systems will be required and the provision of addition theatre extract is also likely. This will have to be assessed and designed on a theatre by theatre basis.

The same considerations apply to both conventional and UCV theatres. The UCV canopy is a re-circulation canopy and as such should have minimal impact on the theatres pressure regime, however due care should be taken not to disturb the canopies clean airflow area with excessive localised air movement and prevent perturbation of the UCV canopy air pattern. It may be necessary to consider a relaxation of minimum air change rates to achieve a neutral pressure cascade however these should not be lower than 18ACH and MUST be agreed with clinical and IPC teams based on clinical risk assessment.

## Coronavirus COVID-19 Guidance

All non-essential materials and equipment should be removed from the theatre and surrounding corridor areas to ensure all cleaning can be undertaken as easily as possible. Specific patient and staff procedures and flows will need to be considered and agreed.

An alternative approach may be to designate a suite of theatre suites within a single location (floor or building) as infectious at which point the entire theatre complex could be isolated from any surrounding clinical areas and used exclusively for only infectious patients. In this case provided the extracted air was discharged to a safe location and all staff wear PPE whenever within the theatre area no or limited modification to ventilation strategies would be necessary.

### **NHS Nightingale Units - Potential Viral load risk and test methodologies**

One of the founding principles of healthcare ventilation is the dilution and removal of airborne contaminants from the patient environment with particular requirements for the air change rates, by room volumes (as specified in HTM 03-01 (2007), via clean airflow paths. In addition to the issue of aero-microbiological loading, there is also the additional risk of oxygen enrichment of the general environment due to the potentially high concentration of patients on ventilators or receiving oxygen based therapy/ treatments.

Both of these issues are addressed by the use of good general ventilation through air changes of the occupied volume of the treatment/ patient space.

The spaces being used generally appear to benefit from very high ceiling void spaces and there is likely to be a high degree of thermal air movement from the bed areas into the open void above, where the existing ventilation system will be located.

It is not possible to know what specific ventilation strategy is deployed into any proposed space, however it is likely that the facility will have some degree of forced mechanical ventilation (both supply and extract) and provided that this does not utilise re-circulation airflows, and achieves in excess of 5 air changes per hour (preferably 10-12ach), the space should have sufficient ventilation. However it may not be practical to provide a fully ducted exhaust ventilation by each bedhead. If recirculation of air is used as part of the existing ventilation/energy strategy then this needs to be assessed and where practical adjusted to maximise fresh air supply.

In order to test and certify the effectiveness of the patient environment, it would be ideal if a two stage approach were adopted;

- Stage 1: pre-occupation
- Stage 2: appropriate intervals during the operational phase of the facility.

### **Stage one (pre-occupation) ventilation test approach.**

Active air sampling for microbiological activity will be of little use prior to patient occupation, it is therefore suggested that a simple test of air movement and dilution be completed at a number of sample bed spaces. This would involve:

- Use of cold smoke (Draeger Smoke Test Puffer) to demonstrate the time taken to clear and general direction of airflow paths - ideally this should occur within a few seconds of release.

## Coronavirus COVID-19 Guidance

- Additionally, a Kata Test Thermometer can be used to produce an accurate air velocity performance reading at the bedhead - ideally this should be in excess of 0.2m/s.

A vane or thermal anemometer is unlikely to produce a reliable test reading at these low velocity levels.

### **Stage two (occupied) ventilation test approach.**

Once occupied, a regular air monitoring regime could be employed to establish and monitor both 'oxygen concentration' levels (using a suitably calibrated and certified oxygen monitor, to BS EN 50104:2019), to enable action to be taken if high levels are found and, 'active air sampling' in the form of occupational environmental air sampling (HSE G409 and Monitoring strategies for toxic substances HSG173 (Second edition) HSE Books 2006 ISBN 0 7176 6188 1) of staff to ensure adequate dilution is being achieved in use.

### **Community Healthcare Ventilation systems**

The practical implication of the guidance is that the current supply and extract ventilation systems offer a dilution effect to the facility and should remain in use and are unlikely to offer any risk to building occupants / users.

Recirculating air conditioning units (also known as split systems) should not be used within clinical care environments as they incorporate both air filtration and water / condensation 'open' trays. These units can provide a location where micro-organisms can become concentrated and proliferate. This is not a specific COVID-19 risk but a general consideration for the use and installation of these units.

Environmental cleaning following a possible case

Once a possible case has been transferred from the primary care premises, the room where the patient was placed should not be used, the room door should remain shut, with windows opened and the air conditioning switched off until it has been cleaned with detergent and disinfectant. Once this process has been completed, the room can be put back in use immediately.

*Note - The air conditioning referred to is understood to be any room mounted 'split' air conditioning unit which only circulates the air within the space and cools or in some models heats the air. As this does not provide fresh air, nor does it remove air to outside the advice to switch it off is related to it not being used whilst windows are open.*

# Coronavirus COVID-19 Guidance

## Non ventilation Considerations

In addition to the ventilation issues associated with the current COVID 19 pandemic, other healthcare related engineering services and operational considerations will need to be assessed and considered. These are likely to include;

- Medical gas capacities and flow rates to deliver required clinical treatments (oxygen, medical air & vacuum).
- Number and location of electrical outlets on essential power supplies, for clinical and medical electronics.
- Provision of suitable emergency lighting
- Patient access and egress / transportation routes through other clinical / public areas.
- A minimum separation distance of between 1 – 2 metres should be maintained between beds
- If temporary separation / partition walls or barriers are constructed to create segregated bed spaces, the fire strategy and fire evacuation plans MUST be reviewed to ensure they remain appropriate. This should involve identification of evacuation routes and places to provide both an immediate safe refuge and a place to continue care and treatment.
- Provision of adequate hand washing facilities.
- Waste collection and storage capacities and locations and transfer routes.
- Surrounding clinical services to avoid close proximity to other 'at risk' patient groups.
- Adequate staff welfare and rest areas if staff numbers are increased to meet clinical needs.

Estates staff are recommended to give consideration to all of the above and where considered necessary review the PHE guidance and consult with their appropriate Authorising Engineer for the associated engineering specialty.

Additional guidance is available in the NHS&I – Novel coronavirus (COVID-19) standard operating procedure – Design Note: COVID-19 ward for intubated patients version 1.0 published 22/03/2020 (Publications approval ref 001559).

# Coronavirus COVID-19 Guidance

## Ventilation Maintenance Considerations

### Ventilation breakdowns and repairs

Any potential contamination risk associated with extract ductwork, fans and filters is likely to be very low. The ventilation system acts to dry out any droplets that are drawn out of a room and if these droplets settle on ductwork or fan surfaces they will very quickly desiccate and are likely to be inactive. Notwithstanding this it is advised that enhanced precautions should be taken by maintenance staff when working on such systems both as a precautionary measure and to provide re-assurance to those undertaking the work.

If a breakdown or internal inspection is required to an extract system from a potentially contaminated area then the following issues should be considered;

- Minimise the tools taken into the area during any period when a system is 'opened up' for maintenance or inspection.
- Following work being completed old or redundant materials / components should be bagged and removed as clinical waste.
- Tools used during the work should be washed / disinfected where practical or wiped down with alcohol based steri-wipes or similar.
- Minimise the number of workers in the immediate area of the work, whilst maintaining safe working conditions and staffing levels (two man working may be necessary if working at height or if moving and handling issues exist).
- All staff should wear appropriate PPE and dress, remove, and dispose of it as detailed below.

Other maintenance activities not directly relating to extract ventilation maintenance such as fire damper drop testing, or ductwork cleanliness inspections will need to be managed so as to ensure that no potential contaminated extract ductwork is opened accidentally. Smoke and fire dampers on extract systems will need to be assessed to ensure routine fire alarm testing does not interrupt or involve extract ductwork ventilation system operation, if being used for isolation protection.

The precautions and method statement detailed above should be adapted / applied to all maintenance staff working in areas where potentially or known infectious patient are or have been located whether working on ventilation systems or any building / estates related element / equipment.

### Filter changing

There are two typical types of filters installed in extract ventilation systems, Safe change types in systems designed to handle toxic or contaminated air (LEV's or HCID units) also known as Bag In Bag Out BIBO type filter units and general filtration (primarily designed to protect fan components and heat exchangers).

Safe change filter units as specifically designed to enable removal and replacement without exposing the maintenance worker to direct contact with the dirty filter. The design of these units can vary so the manufacturers' guidance notes and method statements should be followed to ensure safe removal and disposal.

## Coronavirus COVID-19 Guidance

General filters will not be of a grade that is designed to capture all particles, but will capture some and should be treated carefully. Prior to opening up a unit to remove a general filter a disposal bag should be available. The unit should be switched off and any backflow dampers allowed to close (or if manual – closed) prior to opening up the filter access door. The filter should be removed carefully to minimise the release of any dust/contamination on the filter surfaces and placed directly into the disposal bag. The filter frame should be cleaned ideally with a HEPA filter vacuum cleaner or wiped down with an alcohol based steri-wipe, the used wipes should also be disposed of in the filter disposal bag.

Once clean the new replacement filter can be installed, the unit re-assembled and the fan switch on, once any manual dampers have been re-opened.

### **PPE - Putting on and removing personal protective equipment**

#### **Putting on PPE**

Before donning, healthcare maintenance workers should, remove all nonessential items and tools from overalls and tool bags, ensure they are hydrated, and perform hand hygiene.

Staff should wear the following PPE, put on in the following order:

- Disposable boiler suit/coveralls
- FFP3 respirator and fit check
- eye protection (goggles or face shield)
- disposable gloves

The order given above is practical but the order for putting on is less critical than the order of removal given below. During donning each item must be adjusted as required to ensure it fits correctly and interfaces well with other PPE items.

#### **Removal of PPE**

PPE should be removed in an order that minimises the potential for cross-contamination.

If working within a clinical space after leaving the side room gloves, disposable boiler suit and eye protection should be removed (in that order, where worn) and disposed of as clinical waste. The respirator can be removed and the filters disposed of as clinical waste with the mask being wiped clean with alcohol based steri-wipes or similar.

If working in a plantroom or service area (on remote located ventilation equipment associated with an isolation facility) then the PPE should be removed and bagged prior to leaving the plantroom area. Other staff should not be working in the area whilst the maintenance work to extract ventilation systems is being undertaken.

The order of removal of PPE is suggested as follows, consistent with WHO guidance:

- peel off gloves and dispose in clinical waste
- perform hand hygiene
- remove boiler suit by using a peeling motion, fold in on itself and place in clinical waste bin
- remove goggles or visor only by the headband or sides and dispose in clinical waste
- remove respirator from behind and dispose of filters as clinical waste
- Clean respirator mask housing using alcohol based steri-wipes or similar.
- perform hand and face hygiene

For additional guidance see the PHE COVID-19: Guidance for infection prevention and control in healthcare settings. Version 1.0. Appendix 3 – Best Practice - Putting on and taking off PPE.

# Coronavirus COVID-19 Guidance

## Endnote

Any healthcare organisation which is undertaking works or modifications to their ventilation systems should seek to obtain specialist advice both internally from the organisations own multi-disciplinary team (estates (AP(V)), IPC, Clinical leads, Decontamination leads, Medical Gas AP(MPGS), etc....) but also from an appropriately qualified and experienced Authorising Engineer (Ventilation) or other suitable professional design consultant.

## References

Health Technical Memorandum 03-01 Specialised ventilation for healthcare premises Parts A & B (2007)

Health Building Note 04-01 Supplement 1 Isolation facilities for infectious patients in acute settings

Health Building Note 04-02 Critical Care Units (2013)

2007 Guideline for Isolation Precautions: Preventing Transmission of Infectious Agents in Healthcare Settings - *Jane D. Siegel, MD; Emily Rhinehart, RN MPH CIC; Marguerite Jackson, PhD; Linda Chiarello, RN MS; the Healthcare Infection Control Practices Advisory Committee*  
Guidance Wuhan novel coronavirus (nCoV) infection prevention and control guidance Updated 31st January 2020 - Gov.UK Public Health England

Guidance COVID-19: infection prevention and control guidance PHE.Gov.UK  
NHS&I – Novel coronavirus (COVID-19) standard operating procedure – Design Note: COVID-19 ward for intubated patients version 1.0 published 22/03/2020 (Publications approval ref 001559).

COVID-19 Guidance for infection prevention and control in healthcare settings Adapted from Pandemic Influenza: Guidance for Infection prevention and control in healthcare settings 2020 Issued jointly by the Department of Health and Social Care (DHSC), Public Health Wales (PHW), Public Health Agency (PHA) Northern Ireland, Health Protection Scotland (HPS) and Public Health England as official guidance.

REHVA COVID-19 guidance document March 17, 2020 – Federation of European Heating, Ventilation and Air conditioning Association

The Use of Engineering Measures To Control Airborne Pathogens In Hospital Buildings, Dr Clive Beggs, School of Civil Engineering, University of Leeds, Leeds LS2 9JT, UK